



- NOTE:
- 100 mm THICK & 96kg/m³ DENSITY ROCKWOOL TO BE FITTED TO ALL INSIDE FACES OF WALLS, DOORS, COLUMNS, RADIATOR/ALTERNATOR DUCTS, TOP/BOTTOM BEAMS, ROOF AND BAFFLE PLATES IN ALTERNATOR SIDE EXCEPT LOUVER AREA.
 - TISSUE PAPER USED TO HOLD ROCKWOOL-YARN EMBEDDED RP TISSUE PAPER & PLATED PERFORATED SHEET 0.8 THK., HOLE DIA 5mm, 3HOLES/Cm 2
 - USE ONLY Zn WITH BLUE PASSIVATED FASTNERS.
 - CANOPY PARTS TO BE POWDER COATED IN PE BLUE EXCEPT ROOF AND DUCT LOUVERS WHICH ARE IN RAIL-5000 STRUCTURE FINISH.
 - SHEET THICKNESS FOR ALL DOORS, ROOF AND STIFFENERS IS 1.6mm AND CANOPY BEAMS & COLUMNS SHEET THICKNESS ARE IN 1.2mm THK. CRCA SHEET.
 - SHEET MATL. FOR PRESSED CHANNELS IN MAIN FRAME CRCA 4THK. AND SUBFRAME CRCA 4THK.
 - ALL JOINTS BETWEEN ROOF, COLUMNS AND TOP BEAMS ARE TO BE PASTED WITH 25 mm WIDTH BY 2mm THICK NOISE INSULATING TAPE TO AVOID NOISE LEAKAGES.
 - TOLERANCE ON OVERALL DIMENSIONS IS $\pm 10mm$.
 - ALL DOORS RUBBER BIDDING BULB DIA. 12mm.
 - ALL DOOR LOCKS & HINGES ARE IN STAINLESS STEEL.

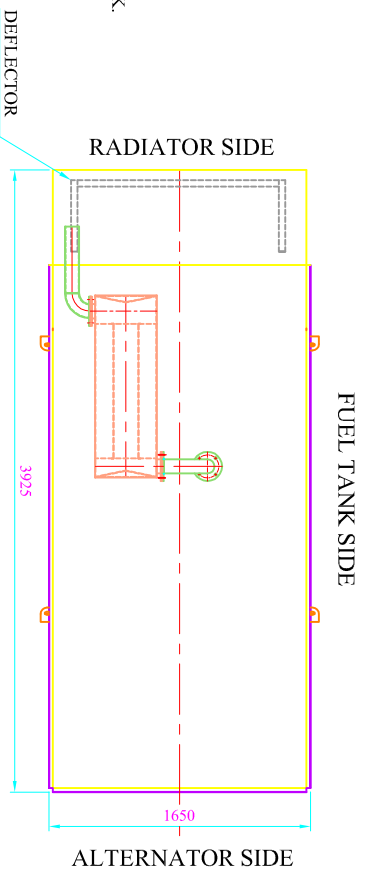


TOP VIEW

ALTERNATOR SIDE

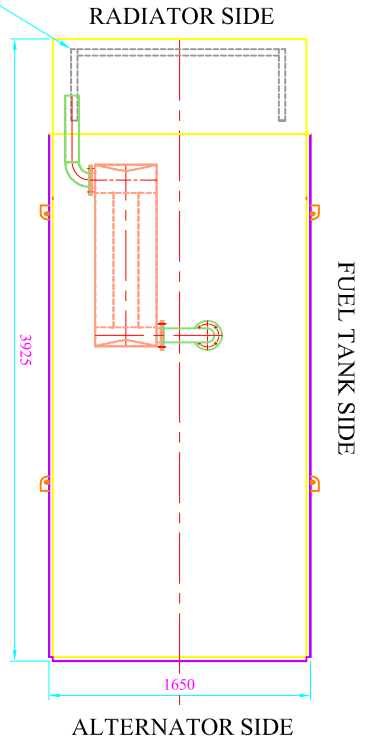

RADIATOR SIDE

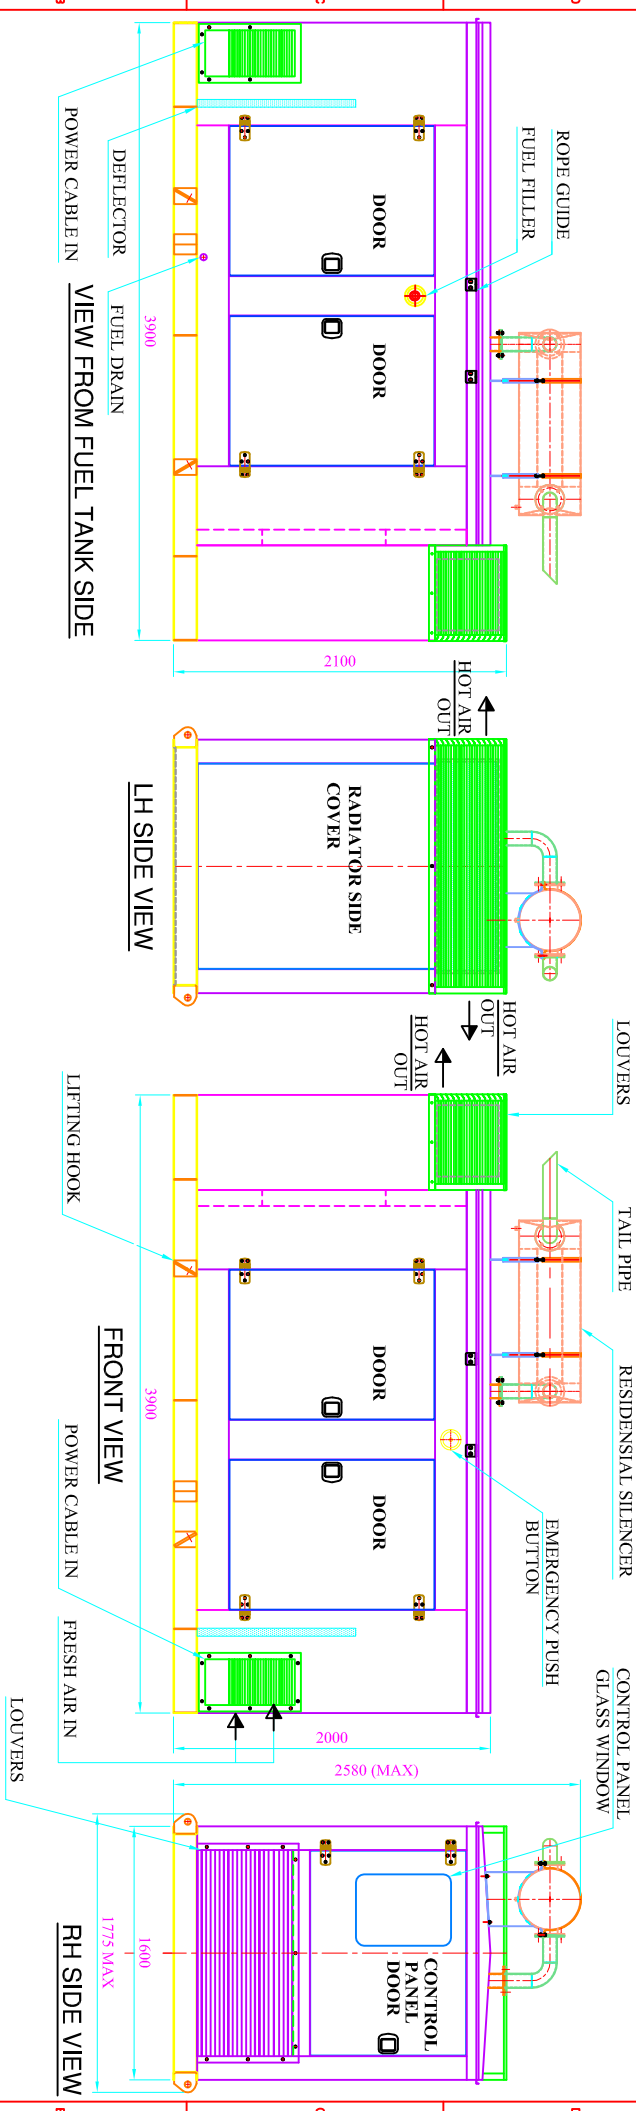

VIEW FROM FUEL TANK SIDE

LH SIDE VIEW

FRONT VIEW

RH SIDE VIEW

UNMENTIONED TOLERANCES		FROM	
UNDER ABOVE	0 6 315 1000	THIS SUPERSEDES	AS PER ISIRI NO.
UP TO	6 315 1000 2000	THIS IS SUPERSEDED BY	FROM
TOL	±0.2 ±0.5 ±0.8 ±1.2	WRITING SPECIFICATION	AS PER ISIRI NO.
ANGLES	±1/2	FOR MATERIAL SIZE	
SURFACE ROUGHNESS (RA) AS PER ISIRI-02-027			
OLD	Ra 3.2 1.6 0.8 0.4 0.2 0.1		
NEW	0.1 0.2 0.4 0.8 1.6 3.2		

REV.	ZONE	DCN No.	BRIEF RECORD	SIGNATURE	DATE

PRINTS ISSUED TO	KIRITLOSÖKAR ELECTRİCİ ÖÖMŞANLILIK LTD. HUBBLI - 580 030 (INDIA)
TITLE	GENERAL ARRANGMENT DRAWING OF-160KVA
DRAWING NO.	160K-6KSWITC1-13 D.G. SET
SCALE	1:1
CHECKED	P.M.D.
APPROVED	
SHEET NO.	22504908R00/000